


Schematic of a Small GWUDI Treatment Plant

EXAMPLE ONLY: NOT FOR CONSTRUCTION

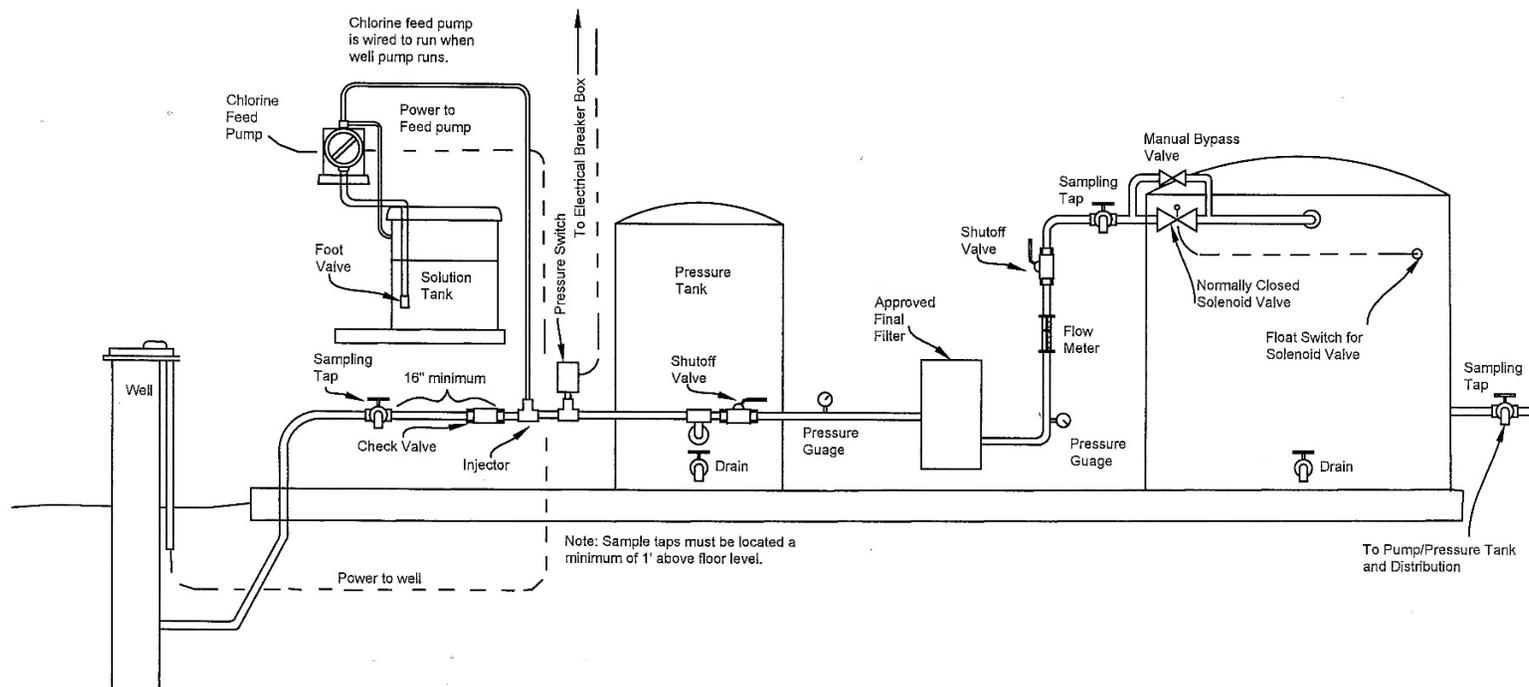

Water is pumped from a well and is treated with chlorine before flowing through filtration and storage. The final filter is rated for the removal of microorganisms. Storage allows for contact time before re-pressurization and service to the distribution system.